


# GENERAL NOTES.

- Ⓐ BACKFLOW PREVENTION ASSEMBLY MUST BE TESTED FOR PROPER OPERATION BY CERTIFIED TESTER BEFORE A FINAL APPROVAL WILL BE ISSUED.
- Ⓑ COPPER FITTINGS SHALL BE CONNECTED WITH LEAD FREE SOLDER JOINTS OR COMPRESSION FITTINGS MAY BE USED.

# LIST OF MATERIALS

- ① APPROVED STAINLESS STEEL, REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY INSTALLED WITH ADEQUATE DRAINAGE FOR RELIEF VALVE FUNCTION.
- ② DOWNSTREAM PIPING TO BE APPROVED PLASTIC OR SSTEEL.
- ③ INLET PIPING TO BE POTABLE WATER PIPING AS DEFINED IN THE UNIFORM PLUMBING CODE.
- ④ LISTED AND APPROVED CARBONATED DRINK DISPENSING UNIT.
- ⑤ LISTED AND APPROVED CARBON DIOXIDE TANK
- ⑥ LISTED AND APPROVED REGULATOR FOR CARBON DIOXIDE GAS.
- ⑦ FLOOR DRAIN OR ADEQUATE MEANS OF DRAINAGE FOR RELIEF VALVE ON BACKFLOW PREVENTION ASSEMBLY.

SUGGESTED INSTALLATION FOR COMPLIANCE WITH CURRENT UNIFORM PLUMBING CODE.

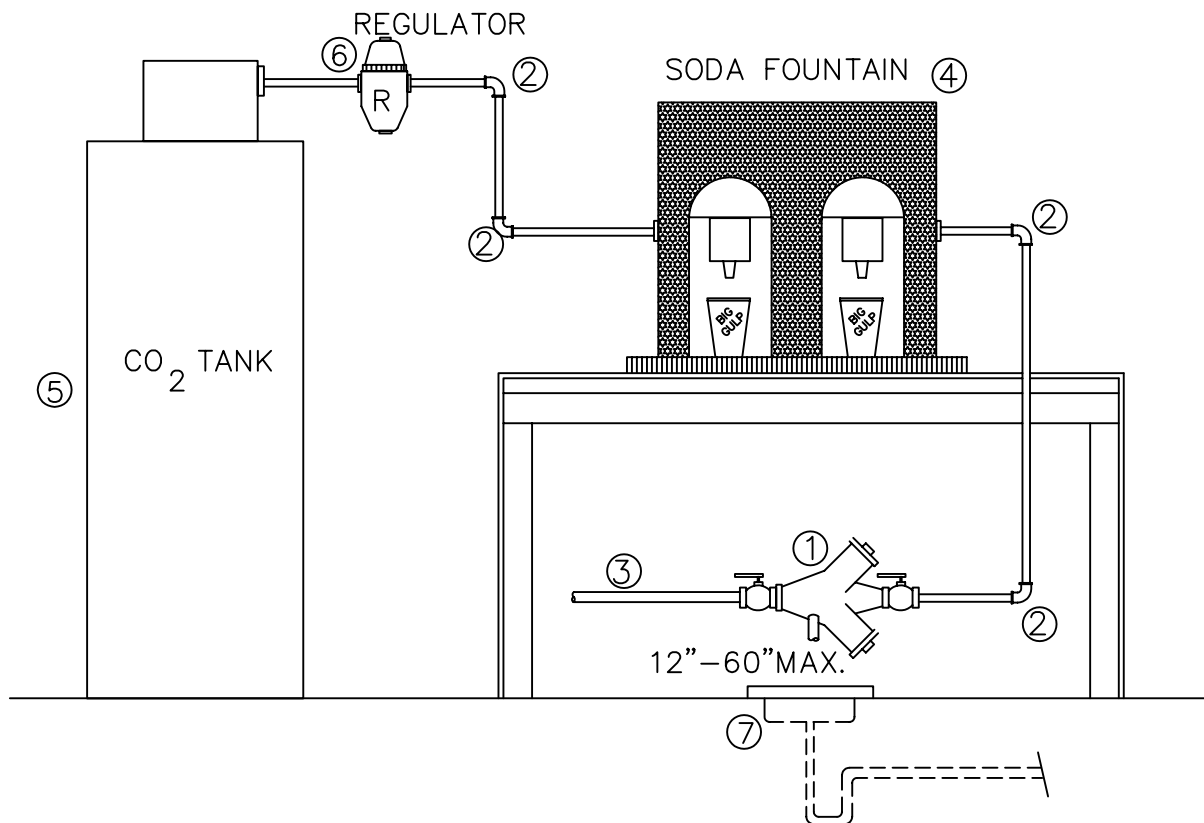

REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY FOR WATER SUPPLY TO CARBONATED DRINK DISPENSING MACHINE.